


E-2080-2-K - WIRING DETAIL

CENTER-ROLL™ DIVIDER CURTAIN
 MAXIMUM 120'-0" LENGTH OR 3000 Sq. Ft.

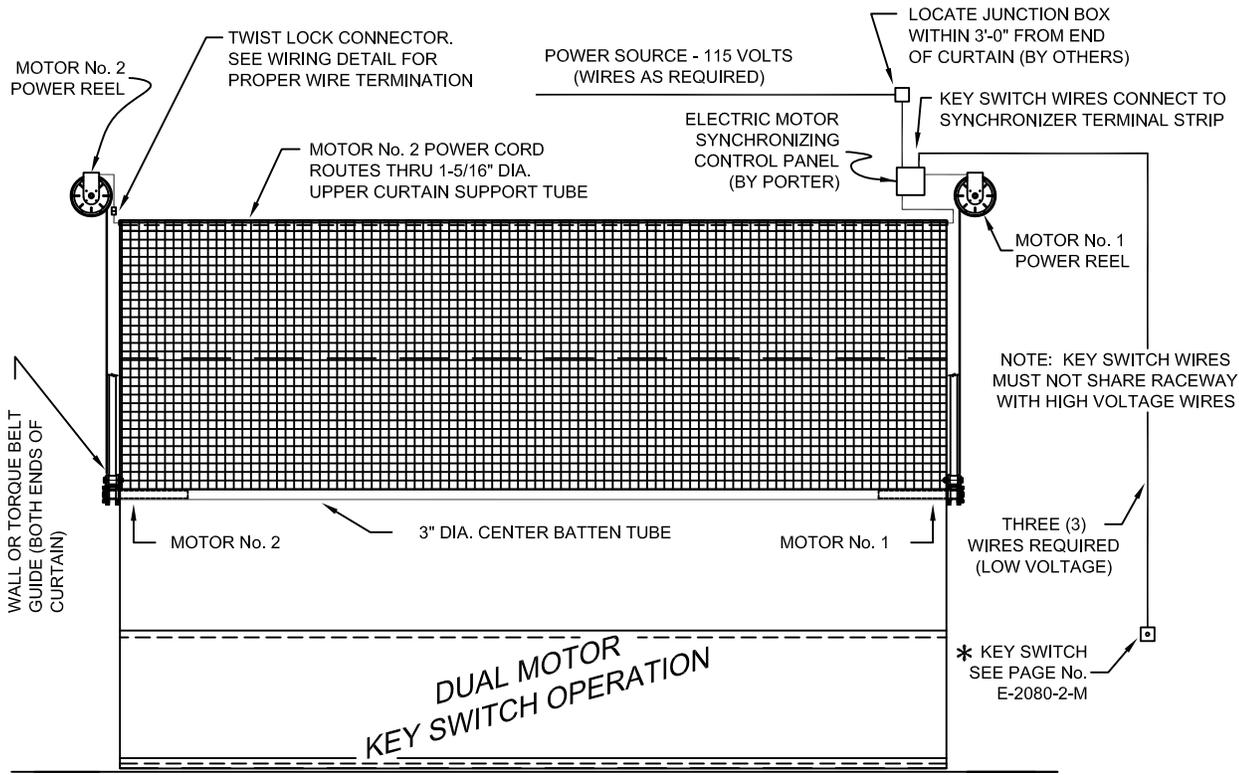

CENTER-ROLL® DIVIDER CURTAIN FIELD WIRING DETAIL

POWER SOURCE REQUIREMENTS
 (EACH ELECTRIC MOTOR)


- 115 VOLTS
- 5 AMPS
- SINGLE PHASE, 60 Hz.

*** CAUTION**

KEY SWITCH MUST BE MOUNTED ON THE WALL IN A LOCATION SO THAT THE EQUIPMENT IT IS CONTROLLING IS IN FULL VIEW OF THE OPERATOR.

WIRING OF ALL ELECTRICAL COMPONENTS SHALL BE IN ACCORDANCE WITH NATIONAL AND LOCAL ELECTRICAL CODES, AND IN ACCORDANCE WITH THESE INSTRUCTIONS.

NOTE - ELECTRICAL CONTRACTOR TO PROVIDE FIELD WIRING AS REQUIRED TO MEET ALL LOCAL ELECTRICAL CODES.

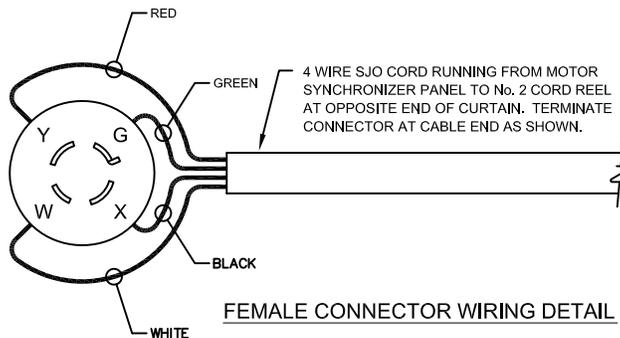

FIELD-WIRING DETAIL FOR CENTER-ROLL® DIVIDER CURTAIN MODELS
 (FOR UNITS EQUIPPED WITH KEY SWITCH OPERATION)

MODEL 92084-___ WALL GUIDE OPERATION DIVIDER CURTAIN (60'-0" TO 120'-0" LG.)

MODEL 92085-___ TORQUE BELT OPERATION DIVIDER CURTAIN (60'-0" TO 120'-0" LG.)



888-277-7778 PORTER@PORTERATHLETIC.COM
 © COPYRIGHT 2014 PORTER ATHLETIC - ALL RIGHTS RESERVED

PROJECT NUMBER _____

PROJECT NAME _____

PORTER

WWW.PORTERATHLETIC.COM/FACILITY

WIRING DETAIL & REQUIREMENT SHEET

E-2080-2-K

6/20/2014